

# Bacnet Room Setpoint & Temp Display

## Descriptions

Bacnet Room Setpoint & Temp Display is designed for environment monitoring and controlling in industrial, commercial and other buildings. These transmitters can be used to monitor air temperature in various industrial and commercial settings. Modbus RS485/Bacnet MS/TP for direct digital reading on all models.

### Highlights:

- The output signals and RS485 are hardened up for over-voltage and power supply crossed over.
- Display in degrees Fahrenheit or Celsius(connection to Bacnet).
- The LCD is a bitmap so we can show network connectivity.
- You can show a user setpoint so you can use it as a room / setpoint display.
- RS485/Bacnet MS/TP for direct digital reading on all models




## Specifications


<b>Typical Application</b>	Wall mount indoors	
<b>Output Signal Type</b>	Jumper select: 4-20mA,0-10V,0-5V	
<b>Output Signal Drive</b>	> 500Ω for mA mode, 75mA max output drive for voltage mode	
<b>RS485 ports</b>	1	
<b>Power</b>	15-24V +/- 10%, AC or DC, 1 watt typical	
<b>Operating Temp</b>	-30~+60°C, 0-95% non condensing	
<b>Plastic Housing</b>	Flammability rating UL 94V0 file E194560	
<b>Display</b>	LCD screen, Resolution 0.1°C, 0.1% RH	
<b>Control Features</b>	N/A	
<b>TEMP</b>	Sensor Type	10K thermistor
	Range	-40~150°C(-60~340°F)
	Accuracy	< ±0.5°C @ 25°C
<b>Size</b>	80.5 (L)x 80.5(W)x22.4(H)mm	

# Bacnet Room Setpoint & Temp Display

## Dimension

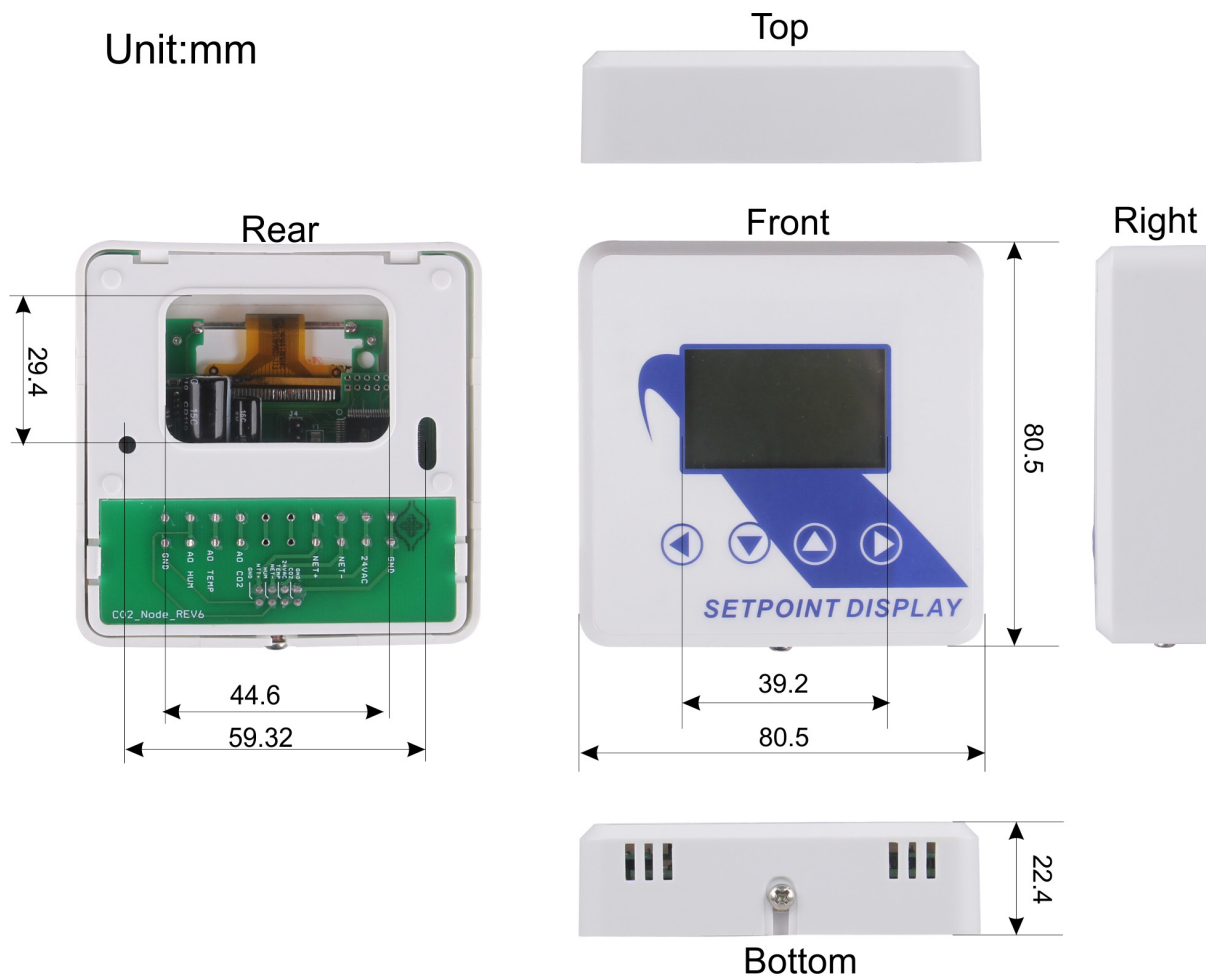

## Backplate Features

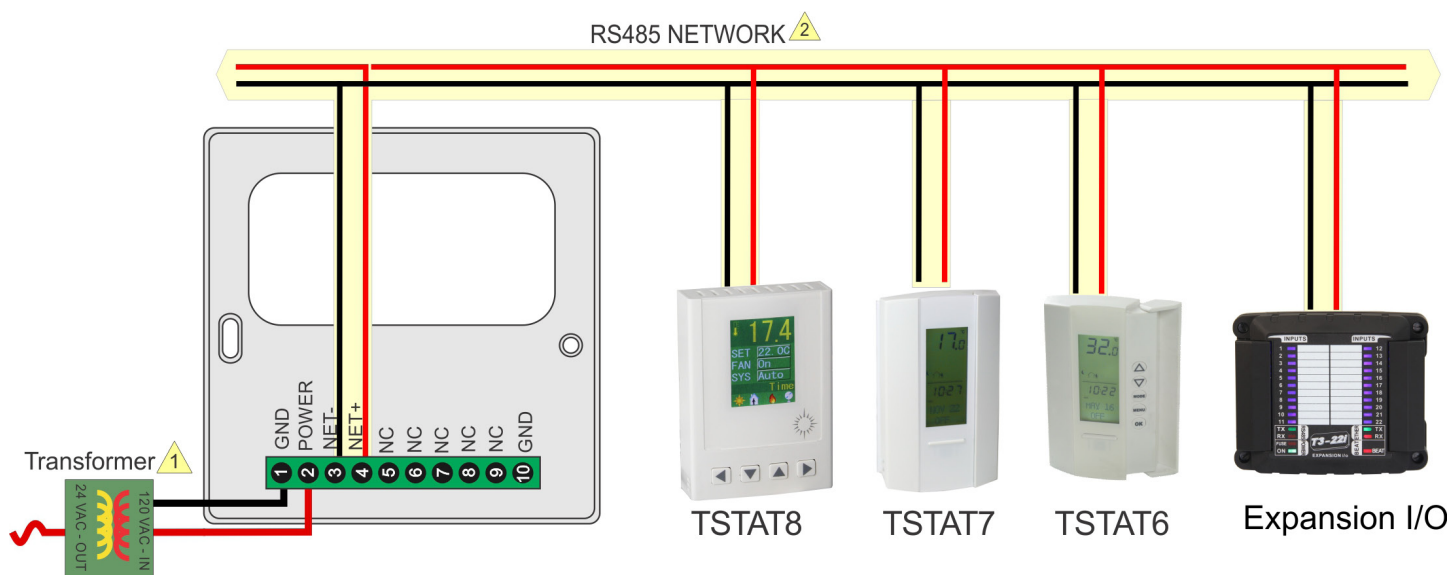

- <sup>1</sup> Power Supply, 15 to 24V, AC or DC
- <sup>2</sup> RS485 Net, 18ga twisted pair typical, optional ground & shield

# Bacnet Room Setpoint & Temp Display



Rear



Rear of device



Front

# Bacnet Room Setpoint & Temp Display

## Modbus Register List

Address	Bytes	Register Description
0 to 3	4	Serial Number - 4 byte value. Read-only
4 to 5	2	Software Version – 2 byte value. Read-only
6	1	ADDRESS. Modbus device address
7	1	Product Model. This is a read-only register that is used by the microcontroller to determine the product
8	1	Hardware Revision. This is a read-only register that is used by the microcontroller to determine the hardware rev
9	1	PIC firmware version
10	1	PLUG_N_PLAY_ADDRESS, 'plug n play' address, used by the network master to resolve address conflicts. See VC code for algorithms
15	1	Baudrate Setting: 0 = 9600bps, 1 = 19200bps
16	1	Firmware Update Register, used to show the status of firmware updates
17 to 99		Blank, for future use
100	2	adc value of co2 voltage output, not used, read only
101	2	adc value of temperature voltage output, not used, read only
102	2	adc value of humidity voltage output, not used, read only
103	2	adc value of co2 current output, not used, read only
104	2	adc value of temperature current output, not used, read only
105	1	adc value of humidity current output, not used, read only
106	2	adc value of on board thermistor sensor, read only
107	2	adc value of on board light sensor, read only
108	2	co2 value (ppm). It will be calibrated if write to it.
109	2	co2 calibration offset. User can change it to calibrate the co2 ppm. It will be changed also if user write the data to register co2 ppm
110	1	Delta value for eliminating the pulse ppm value. The default value is 200.
111	2	Filter times, make the ppm value go smooth. The default value is 5.
112	2	The fair alarm ppm setpoint of co2 sensor.
113	2	The poor alarm ppm setpoint of co2 sensor.
114	1	co2 alarm status:
		0b'xxxx 1xxx': co2 poor
		0b'xxxx 01xx': co2 fair
		0b'xxxx 001x': co2 good
115	1	the version number of humidity sensor
116	2	the relative humidity
117	2	the frequency value read from humidity sensor, read only
118	1	the number of calibration points of the humidity sensor
119	2	degree celsius temperature value of the humidity sensor
120	2	degree fahrenheit temperature value of the humidity sensor
121	2	celsius degree temperature value of the on board thermistor sensor
122	2	fahrenheit degree temperature value of the on board thermistor sensor

# Bacnet Room Setpoint & Temp Display

## Modbus Register List

Address	Bytes	Register Description
123	2	the offset for calibrating the on board thermistor sensor
124	1	select the temperature direct to analog output: 0: on board thermistor sensor, default setting 1: humidity sensor
125	1	select the temperature unit direct to analog output: 0: degree celsius 1: degree fahrenheit, default setting
126	2	Lighting value, for feature
127	1	analog output mode, change it by setting the jumper (J20) on the board, read only
128	2	the minimum value of temperature directs to the analog output
129	2	the maximum value of temperature directs to the analog output
130	2	the minimum value of humidity directs to the analog output
131	2	the maximum value of humidity directs to the analog output
132	2	the minimum value of co2 directs to the analog output
133	2	the maximum value of co2 directs to the analog output
		e.g. co2 output: if the co2 ppm is 1000, the (minimum value, maximum value) = (0, 3000), then
		1. setting J20 to select 0V-10V output mode, so the co2 output is about $((1000\text{ppm} / (3000\text{ppm} - 0\text{ppm})) * (10\text{V} - 0\text{V})) + 0\text{V} = 3.3\text{V}$
		2. setting J20 to select 0V-5V output mode, so the co2 output is about $((1000\text{ppm} / (3000\text{ppm} - 0\text{ppm})) * (5\text{V} - 0\text{V})) + 0\text{V} = 1.65\text{V}$
		3. setting J20 to select 4mA-20mA output mode, so the co2 output is about $((1000\text{ppm} / (3000\text{ppm} - 0\text{ppm})) * (20\text{mA} - 4\text{mA})) + 4\text{mA} = 9.3\text{mA}$
500	1	co2 automatic compensation background enable or disable. 0 = Disable, 1 = Enable.
501	2	"Background CO2", default is 400ppm, minimum is 390, max is 500.
502	1	Maximum adjustment per day" default is 1ppm, max is 10 ppm, minimum is 1.
503	1	"Number of days to watch for minimum", default is 7 days. Max is 30 days. Minimum is 2 days.
505	2	co2 background calibration offset.

# Bacnet Room Setpoint & Temp Display

## Bacnet Object List

Bacnet AV	Description
AV1	SerialNumber LowByte
AV2	SerialNumber HighByte
AV3	SoftWare Version
AV4	Modbus id
AV5	Product Model
AV6	Instance
AV7	Station Number
AV8	BaudRate
AV9	Update
AV10	Protocol switch. 0 = MODBUS,1=MSTP.
AV11	Auto/Manual,Analog output auto/manual control. Bit 1 directs to temperature output, 0=Auto, 1=Manual.
AV12	Dew Point
AV13	Passwords
AV14	Mixing Ratio, the mass of water over the mass of dry gas, [g/kg]
AV15	Enthalpy of the air, [kJ/kg]
AV16	Spare
AV17	Temperature Offset
AV18~AV19	Spare
AV20	Temperature Filter
AV21	Spare
AV22	Temperature Unit
AV23	Output Mode
AV24~ AV25	Spare
AV26	Minimal Range for temperature
AV27	Maxium Range for temperature
AV28~AV30	Spare
AV31	Temperature Setpoint
AV32	Temperature

Analog Input	Analog Input and Description
AI1	Spare
AI2	Temperature
AI3	Spare

## Bacnet Room Setpoint & Temp Display

Analog Output	Analog Output and Description
AO1	Spare
AO2	Temperature
AO3	Spare

# Bacnet Room Setpoint & Temp Display

## Choice Of Display

Can change the display of LCD by using T3000 front end, The green part change the main display and red part is for the scroll line at the bottom side of LCD.

Serial Number :	<input type="text" value="113108"/>	Baudrate :	<input type="text" value="19200"/>	The fair alarm
Modbus ID :	<input type="text" value="253"/>	Protocol :	<input type="text" value="Bacnet MSTP"/>	The poor alarm
Roll time interval :	<input type="text" value="5"/>	Temperature Unit :	<input type="text" value="Deg.C"/>	
Badlight time (On):	<input type="text" value="30"/>			

	Show	Hide
Temperature	<input checked="" type="radio"/>	<input type="radio"/>
Humidity	<input checked="" type="radio"/>	<input type="radio"/>
CO2	<input type="radio"/>	<input checked="" type="radio"/>
Temperature Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
Humidity Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
CO2 Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
User Message	<input type="radio"/>	<input checked="" type="radio"/>
AQ Value	<input type="radio"/>	<input checked="" type="radio"/>

Scroll Display	Show	Hide
TX / RX	<input checked="" type="radio"/>	<input type="radio"/>
Alarm	<input checked="" type="radio"/>	<input type="radio"/>
CO2 Status	<input type="radio"/>	<input checked="" type="radio"/>
Temperature	<input checked="" type="radio"/>	<input type="radio"/>
Humidity	<input type="radio"/>	<input checked="" type="radio"/>
CO2	<input type="radio"/>	<input checked="" type="radio"/>
Temperature Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
Humidity Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
CO2 Setpoint	<input type="radio"/>	<input checked="" type="radio"/>
Outdoor Temperature	<input type="radio"/>	<input checked="" type="radio"/>
User Message	<input type="radio"/>	<input checked="" type="radio"/>